

编号: hcpg06-XXX

Date: 2006-XX-XX

涡旋压缩机技术规格书

Specification for Scroll Compressor

Model: 403DH-64B2

客户名称:			
客 户 确 认			
确 认 日 期		空 调 器 型 号	



Hitachi Compressor Products (Guangzhou) Co., Ltd.

广州日立压缩机有限公司

承 认	担 当	

1. 规格 Specification

1.1 压缩机 Compressor

压缩机型号 Compressor Model	403DH-64B2
压缩机型式 Compressor Type	全封闭型电动压缩机 Hermetic Motor Compressor
压缩机方式 Compression Type	涡旋式 Scroll Type
使用冷媒 Refrigerant	R22
排气容积 Displacement	64cm ³ /rev
润滑油 / 油量 Oil / Oil Charge	SUNISO 4GSD / 1200ml
涂装 Painting	黑色 Black Color Paint
总质量(含油) Net Mass(Including Oil)	35kg
吸气管接口内径 Suction Accept I.D	Φ 22.2mm
排气管接口内径 Discharge Accept I.D	Φ 12.9mm

1.2 电机 Motor

电动机型式 / 起动方式 Motor Type / Start Mode	三相感应电机 / 直接 3 Phase Induction Motor / Direct Start
极数 Pole	2 极 2 Pole
额定电压 / 频率 Rated Voltage / Frequency	3Ph - 220V-50Hz / 3Ph - 220V-60Hz
额定转数 Rated Revolution	2,921 [50Hz] / 3,470 [60Hz]
绝缘等级 Insulation Class	F 级 F Class
绕组阻抗 Winding Resistance (at 20℃)	1.006±7%Ω

1.3 性能 Performance

制冷能力 Capacity	11,800W [50Hz] / 14,200W [60Hz]
输入功率 Motor Input	3,600W [50Hz] / 4,350W [60Hz]
能效比 EER	3.25W/W
运行电流 Running Current	11.24A [50Hz] / 12.9A [60Hz]
堵转电流 Locked Rotor Ampere	97A [50Hz] / 86A [60Hz]
噪音 Sound Level	60dB (A) Max.
振动 Vibration	15m/s ² Max.

403DH-64B2

※ 制冷能力测试条件 Test condition of cooling capacity:

冷凝温度 Condensing temp.: 54.4 °C

蒸发温度 Evaporating temp.: 7.2 °C

回气温度 Return gas temp.: 18.3 °C

周围温度 Ambient temp.: 35.0 °C

膨胀阀前液体温度 Liquid temp.: 46.1°C

1.4 一般特性 Characteristics

气密试验压力 Leak Tight Pressure	3.0MPa[高压侧 H. P. Side] / 1.5MPa[低压侧 L. P. Side]
耐压试验压力 Hydrostatic Strength Pressure	4.5MPa[高压侧 H. P. Side] / 2.3MPa[低压侧 L. P. Side]
绝缘阻抗 Insulation Resistance	10MΩ Min.
绝缘耐压 Withstand Voltage	1,500V-1min.
残余水分量 Residual Moisture	350mg Max.
含尘量 Residual Impurities	100mg Max.

1.5 电气部品规格 Electrical Component

品名 Parts Name		规格 Specification
过载保护器(内置) Overload Protector (Internal)	型号 Model	34HM405-14
	Run	断开温度 Open Temp.
		160±5°C
	U/T	闭合温度 Close Temp.
		61±9°C
	U/T	动作电流特性 Amps To Trip
		120°C 20.0~24.4A
	U/T	动作时间特性 Time To Trip
		85A 2~10s

2. 压缩机配件 Accessories Of Compressor

NO.	名称 Parts Name	数量 Qty	代号 Drawing NO.	备注 Remarks
1	支撑螺栓 Bolt	4	TP1-101	标准部件 Standard Parts
2	防振胶垫 Rubber Grommet B	4	TP1-102	
3	防振胶座 Rubber Grommet A	4	TP1-103	
4	垫圈 Washer	4	TP1-104	
5	M6 螺母 M6 Screw Nut	4	GB41-86-M6	
6	M8 螺母 M8 Screw Nut	4	GB41-86-M8	
7	弹性垫圈 Spring Washer	4	GB93-87-6	
8	温控器挡板 Thermostat Holder	1	TP1-105	选择部件 Option Parts
9	排气温控器 Discharge Thermostat	1	TP1-106	
10	热油器 Crankcase Heater	1	TP1-110	

3. 使用条件范围 Operating Conditions

蒸发温度 Evaporating Temp.	-15~15°C
排气温度 Discharge Temp.	(冷凝温度+15°C)~120°C以下 (Condensing Temp. +15°C)~120°C Max.
绕组温度 Winding Temp.	120°C以下 Max.
压缩机外壳温度 Shell Temp.	115°C以下 Max.
运转电压 Running Voltage	额定电压±10% Rated Voltage ±10%

起动电压 Start Up Voltage	额定电压的 85% 以上（压缩机端子间电压） Minimum 85% of the rated voltage measured at compressor terminals.
频率范围 Frequency Range	额定频率 $\pm 2\%$ Rated Frequency $\pm 2\%$
吸气压力 Suction Pressure	0.1~0.7MPa（起动、除霜等短时间运转除外；Except the short period such as start, defrost）
排气压力 Discharge Pressure	1.1~2.8MPa
压力比 Pressure Ratio	2~7.5（起动、除霜等短时间运转除外；Except the short period such as start, defrost）
起动时的压力差 Pressure Difference At Starting	排气压力-吸气压力 $\leq 0.30\text{MPa}$ D.P. - S.P. less than 0.30MPa
启停周期 On/Off Period	周期为 10 分钟以上，停止时间必须 3 分钟以上 10 minutes min/cycle, OFF should be over 3 minutes
最低油量 Minimum Oil Charge	400ml Min.
异常升压/降压 Abnormal Press. Rise/Drop	上升: 3.0MPa 以下 Rise: 3.0MPa Max. 下降: 0.2MPa 以上 Drop: 0.2MPa Min.
配管（铜管）应力 Copper Piping Stress	启动时: 50MPa 以下 Start: 50MPa Max. 运转时: 10MPa 以下 Run: 10MPa Max.
冷媒水分含量 Refrigerant Moisture Level	60ppm 以下 Max.
系统固体杂质含量 Solid Impurities Level	100mg 以下 Max.
运转倾斜角度 Tilt In Operation	压缩机倾斜最大 5° 以内 5 deg. Max.

※ 其他注意事项 Remarks:

1. 制冷系统 The refrigeration system

- 1) 润滑油与冷媒的重量比（润滑油/冷媒）应在 0.4 以上；

The ratio of oil to the refrigerant (oil/refrigerant) should be higher than 0.4 in weight basis.

- 2) 当系统中压缩机存在液态冷媒回流情况时，应采用储液罐等设计避免液态冷媒回流；

When the compressor in the system has the liquid refrigerant flooding back operation, the accumulator is required.

- 3) 向压缩机充油或冷媒时，必须从排气侧进行；

Charge oil or refrigerant from the discharge pipe.

- 4) 系统应设置高压压力开关，参考设定值为 $2.8 \pm 0.1\text{MPa}$ 。

Using high pressure switch in the refrigeration system is required, we advise setting pressure as follow: $2.8 \pm 0.1\text{MPa}$,

2. 压缩机在去除吸、排气接头盖后，请勿放置 10 分钟以上；

Installation shall be completed within 10 minutes after removing the caps of suction and discharge tube.

3. 请勿压缩空气；

Do not compress air.

4. 在真空状态下请勿通电；

Do not energize under vacuumed condition.

5. 热泵系统必须在压缩机底部安装油加热器（40~80W, 220V）；

Crankcase heater is required if the refrigeration system is heat pump.

6. 运转时, 各相间的电压偏差应在额定电压的 3%以内;

Voltage (run): Voltage deviation each phase shall be within 3% of the rated voltage.

7. 请勿反向旋转;

Do not reverse rotate.

8. 压缩机的接地装置应永久与制冷器具的接地装置连接;

The compressor's ground should be connected with that of refrigeration system permanently and firmly.

9. 成箱压缩机包装件的叠放堆码极限为 2 箱, 装卸过程中严禁翻滚。

Pile limits 2 pallet. Tumbling is forbidden during handling.

4. 附图 Attachment

A-1 压缩机外形图 Dimension of Compressor

A-2 防振胶座装配图 Mounting Assembly

A-3 压缩机性能曲线 1 Compressor Performance Curve 1

A-4 压缩机性能曲线 2 Compressor Performance Curve 2

A-5 基本电气原理图 (三相压缩机) Basic Circuit Diagram (Three Phase Compressor)





A-6 排气温控器组装图及零件图 Discharge Gas Thermostat Assembly Diagram

A-7 过载保护器 U/T 曲线 Overload Protector U/T Curve


A-8 过载保护器 S/T 曲线 Overload Protector S/T Curve

A-9 热油器安装图 Crankcase Heater Assembly

A-1 压缩机外形图 Dimension of Compressor (403DH-64B2)

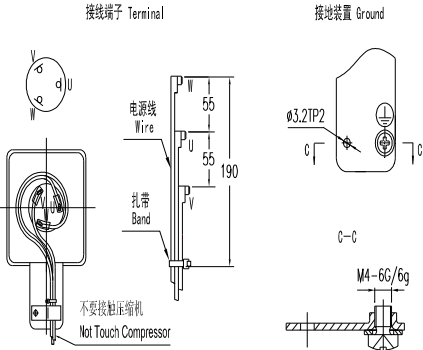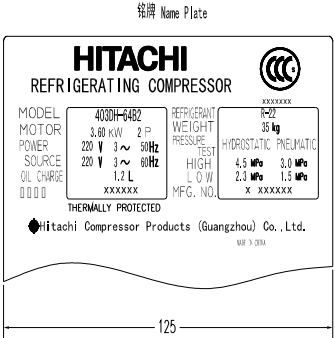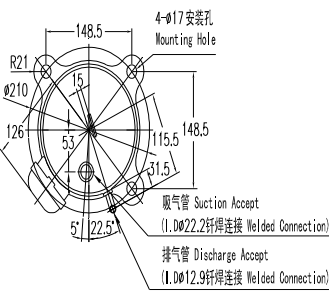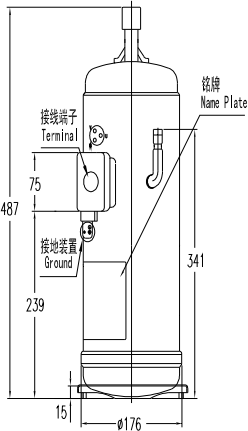



A-2 防震胶座装配图 Mounting Assembly

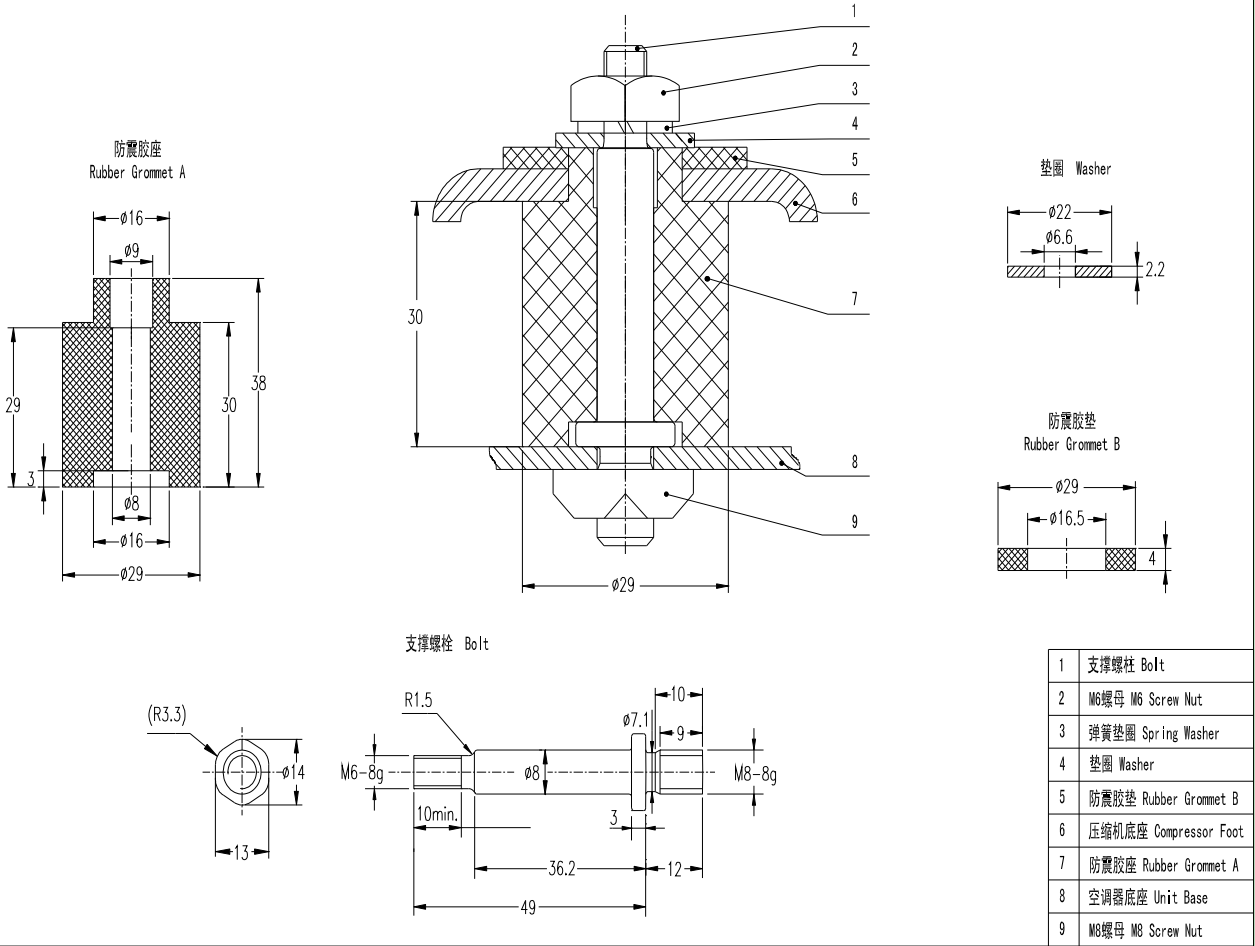


1-3 压缩机性能曲线 (Compressor Performance Curve) (403DH-64B2)

制冷剂 (Refrigerant)	R404A/R507c
制冷剂 (Refrigerant)	R22
吸气过热度 (Suction Superheat)	11.1℃
过热度 (Superheat)	11.1℃

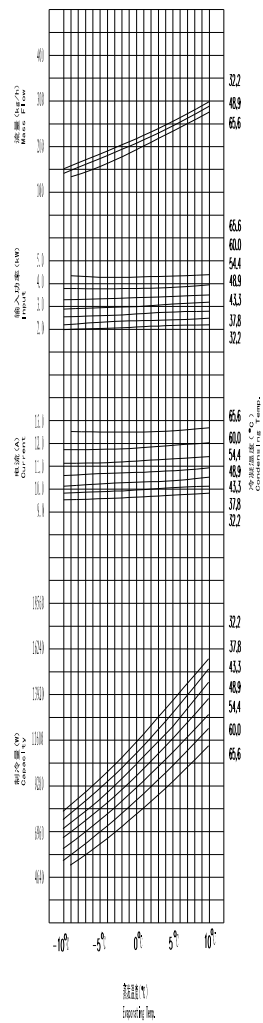

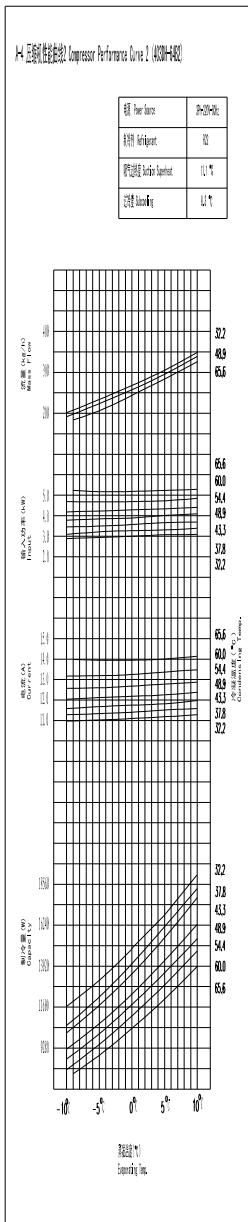

A-5 基本电气原理图 (三相压缩机) Basic Circuit Diagram (Three Phase Compressor)

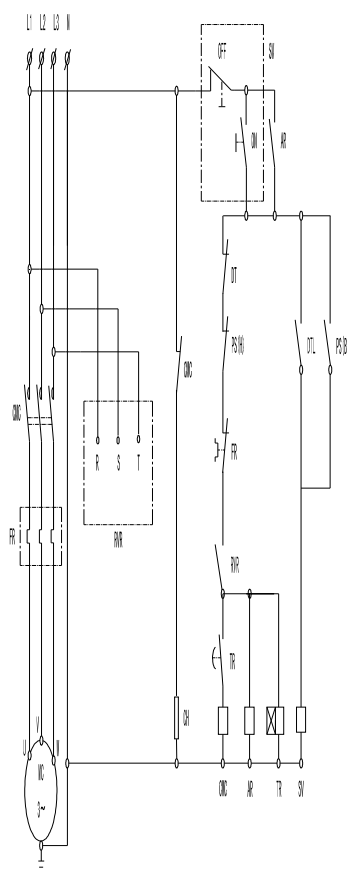


代号 Code	名称 Parts Name	备注 Remarks	代号 Code	名称 Parts Name	备注 Remarks
M	三相压缩机 Three Phase Compressor		MT	微气温控器 Micro-gas Thermostat	Close: 100°C±5°C Open: 130°C±5°C
PS	交流接触器 Magnetic Contactor		PS	高压压力开关 High Pressure Switch	设定压力: 2.0MPa Set Pressure: 2.0MPa
OR	过流继电器 Overcurrent Relay		PSB	液旁通压力开关 Pressure Switch for Liquid Bypass	Close: 2.5MPa±0.1MPa Open: 2.1MPa±0.1MPa
SV	电磁阀 Solenoid Valve		GT	液旁通气温控器 Gas Thermostat for Liquid Bypass	液旁通40°C For Cooling 40°C
SW	开关 Switch		GT	液旁通气温控器 Gas Thermostat for Liquid Bypass	Close: 100°C±5°C Open: 70°C±5°C
TR	时间继电器 Time Relay		TR	时间继电器 Timer	设定时间: 15分钟 Set Time: 15 minutes
HT	加热器 Heater				

注: 带*号零件由用户自备。


Note: All the parts marks "*" should prepared by customer.

A-1 排气温控器组装图及零件图 Discharge Gas Thermostat Assembly Diagram




序号 No.	名称 Parts Name	备注 Remarks
1	制冷剂罐装 R12	Charge 130±5°C, Charge 100±5°C
2	温度控制阀 R12 444	
3	压缩机 Compressor	

0.1




22888 L. Hb



A-7 过载保护器 U/T 曲线 Overload Protector U/T Curve

34HM MOTOR PROTECTOR ULTIMATE TRIP CURVES

Ultimate Trip Current VS. Protector Ambient Temperature (Approximate).
To Be Used Only For Selecting Samples For Motor Verification Test.

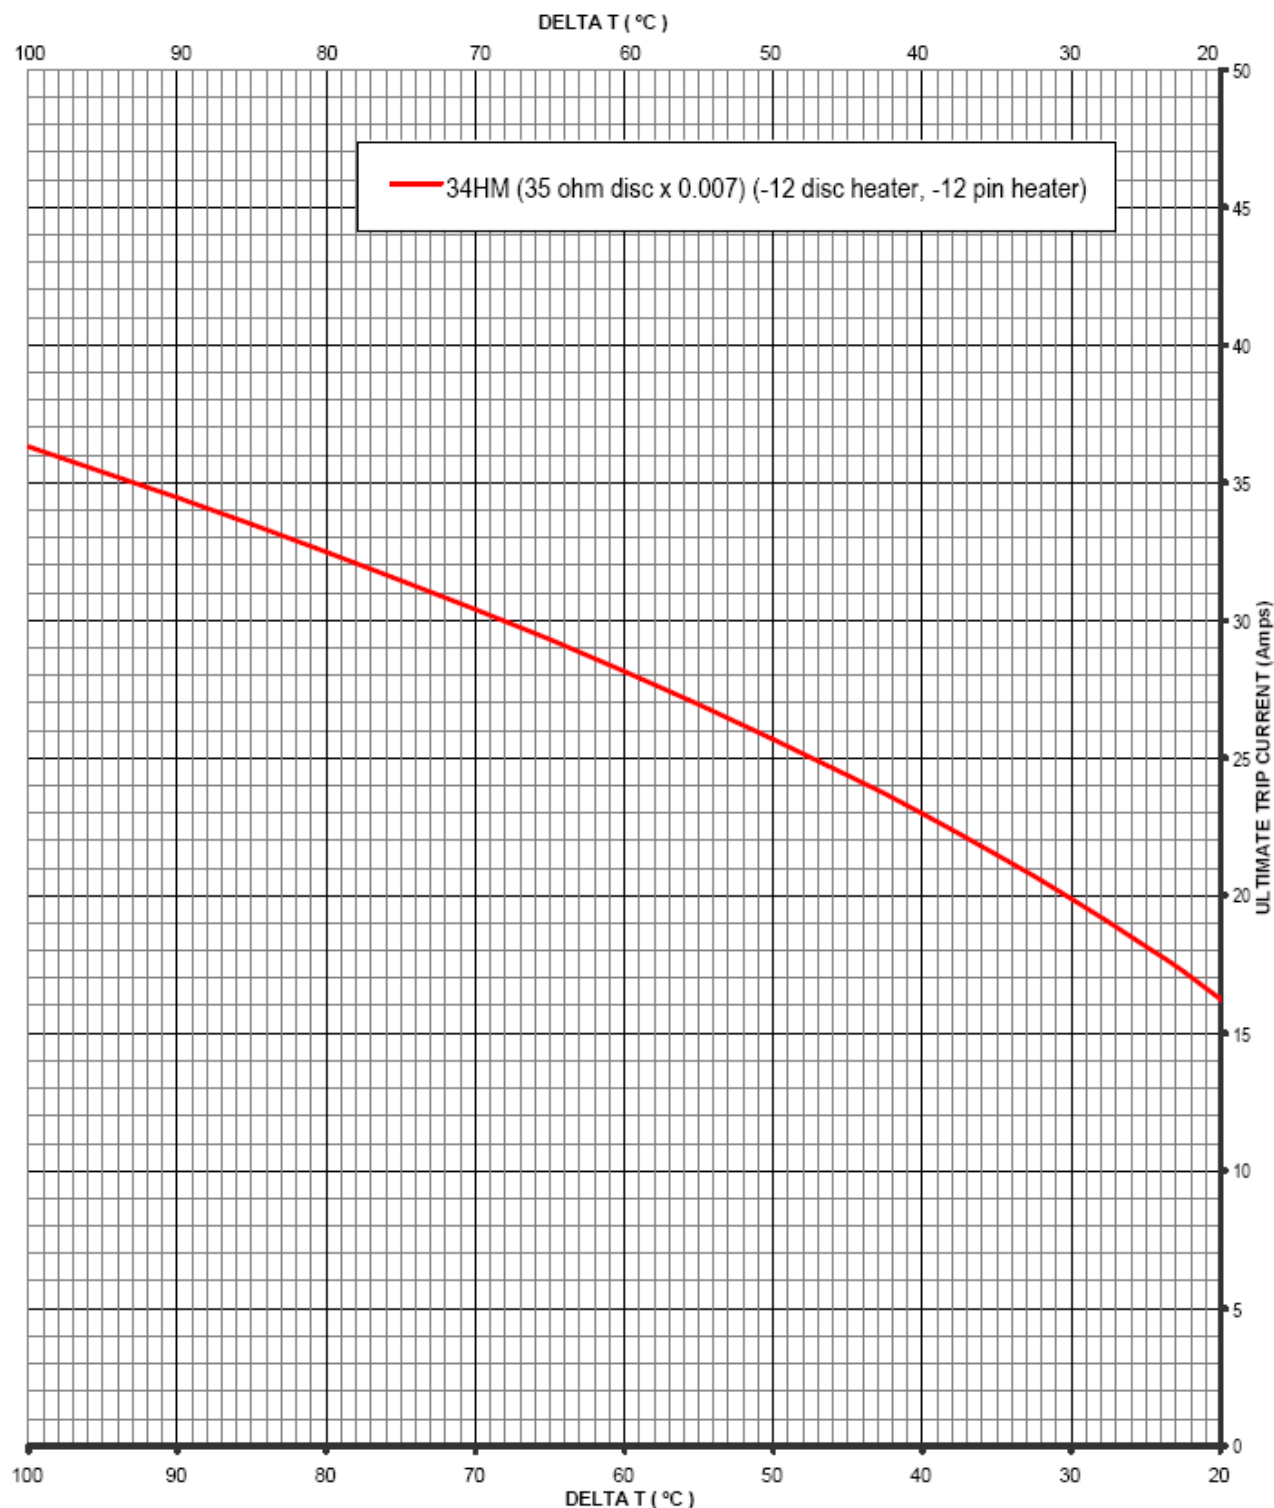

A-8 过载保护器 S/T 曲线 Overload Protector S/T Curve

34HM MOTOR PROTECTOR SHORT TIME CURVES

Average First Cycle Tripping Time VS. Current In 25 °C Ambient (Approximate).
To Be Used Only For Selecting Samples For Motor Verification Test.

